



Safety Certificate from Tamil Nadu Electrical Inspectorate (TNEI)


Procedure, List of Supporting Documents and Fees

Table of Contents


1 Procedure	3
2 Checklist of supporting documents	6
3 Fees.....	6

1 Procedure

Procedure for Obtaining Safety Certificate- < 630 KVA

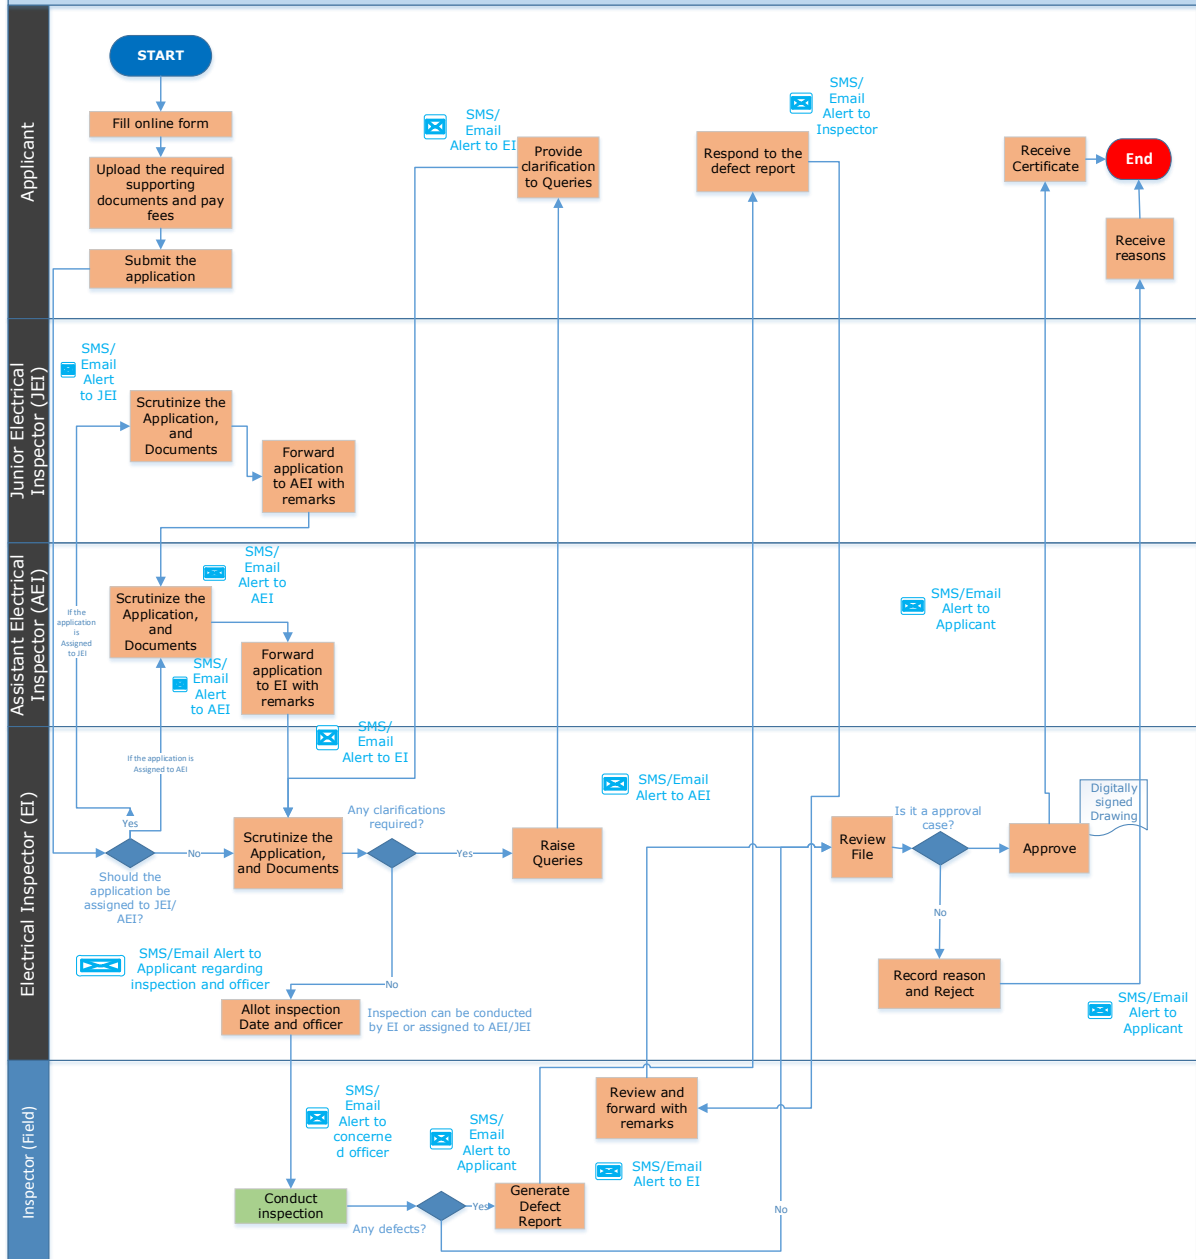

Procedure for Obtaining Safety Certificate (>630 KVA for Chennai Region and > 2500 KVA in Coimbatore region)

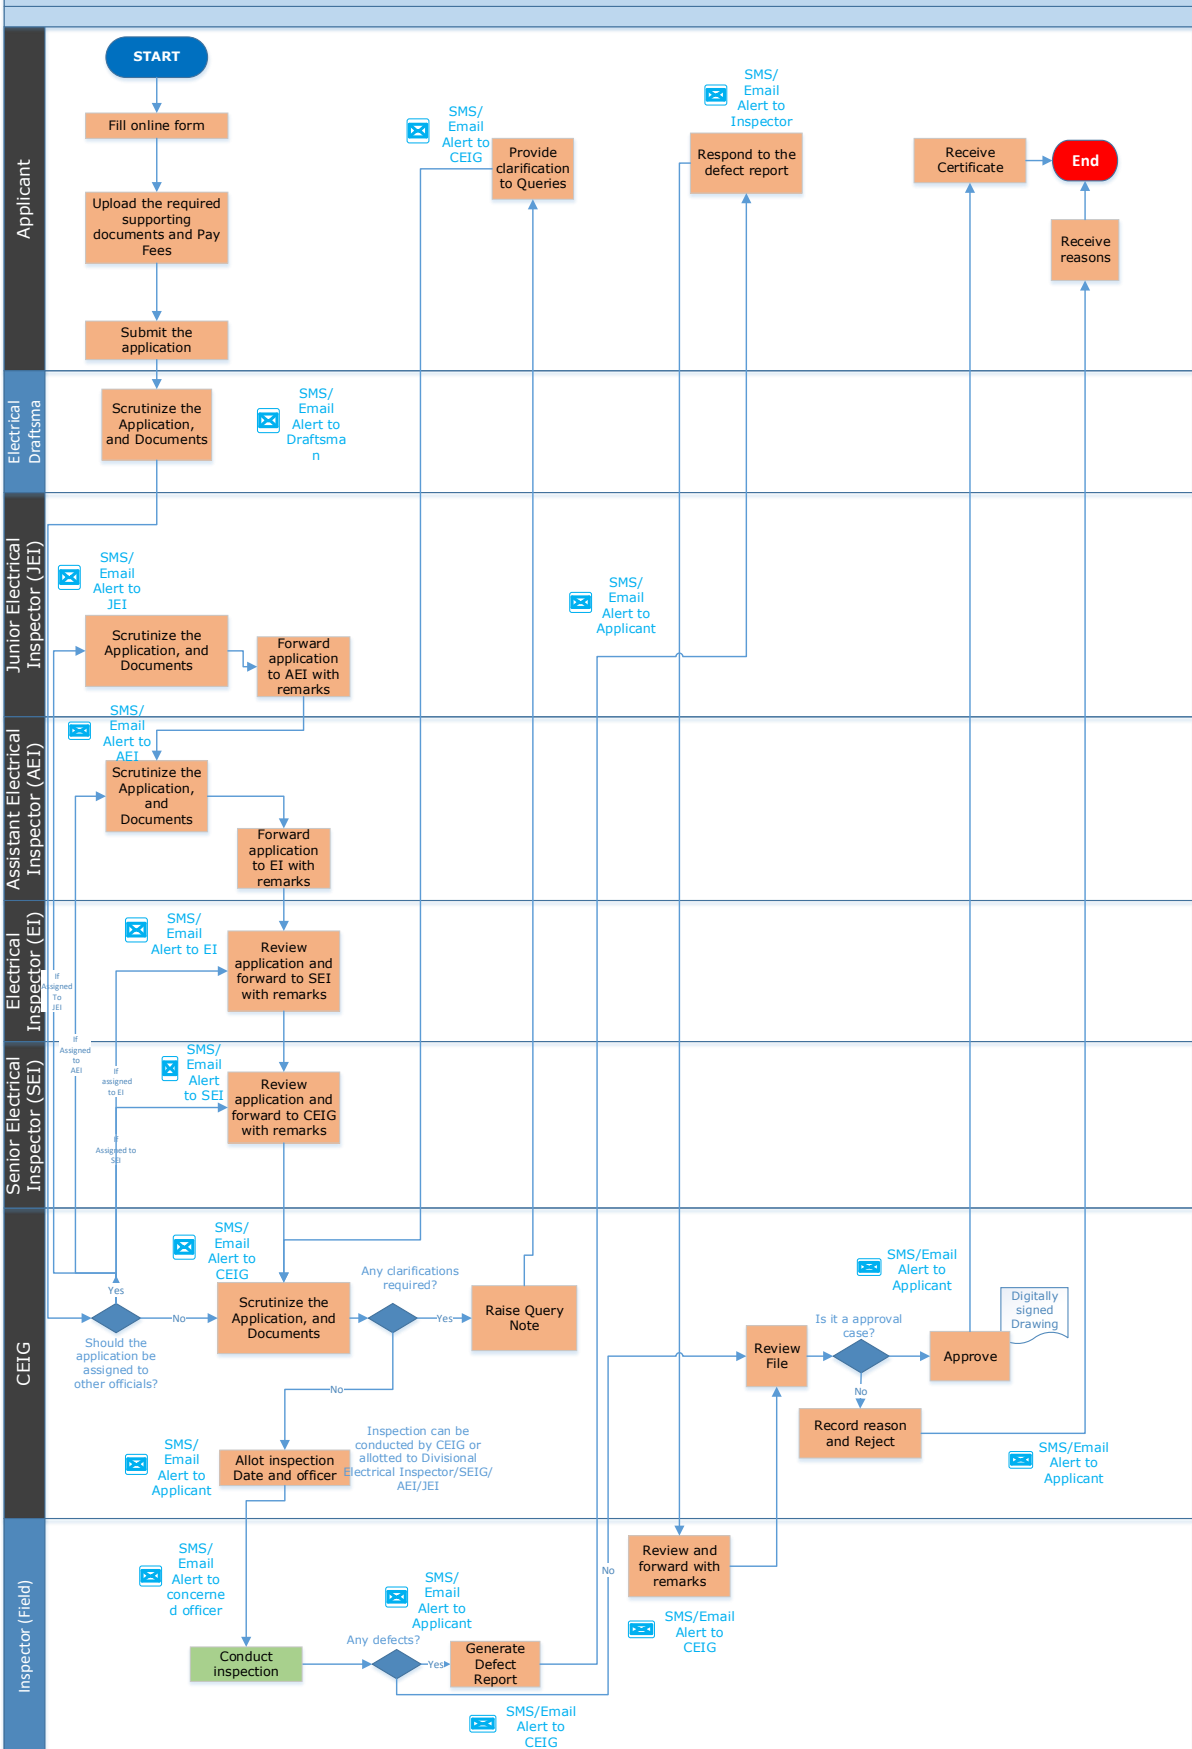

*In Coimbatore region, the application will be forwarded from AEI to SEI, authority EI will not be involved

2 Checklist of supporting documents

#	Item
1	Letter requesting for inspection and issue of Safety Certificate (on Applicant's Letter Head)
2	Contractor's work completion report as per IS 732: 1989
3	Manufacturer's Test certificates of E.H.V / H.V Transformer / Generator/ Motor/ Switchgear/ cable / equipment, if applicable
4	Invoice of H.T. cable if applicable
5	Copy of appointment order of Supervisory Competency Certificate (SCC) holder
6	Copy of consent letter from SCC holder
7	Item-wise compliance report as stipulated in the drawing scrutiny report, if any
8	Load sanction letter from TANGEDCO, if not provided during the drawing approval stage
9	Document (if any) raised in the drawing scrutiny report.

3 Fees

S.No	Equipment	Rate (Rs.) for inspection under Regulation 43
1	EHV/HV Transformers	
	(i) Upto 10,000 KVA	5000
	(ii) Above > 10,000 KVA	10000
2	HV/HV Transformers	
	(i) Upto 3000 KVA	2500
	(ii) 3000 KVA – 5000 KVA	3000
	(iii) Above 5000 KVA	3500
3	HV/MV Transformers	
	(i) Upto 500 KVA	750
	(ii) 500 KVA – 1000 KVA	1000
	(iii) Above 1000 KVA	1500
4	HV Equipment	
	(i) Upto 500 KVA	750
	(ii) Above 500 KVA	1000
5	HV Generators	
	(i) Upto 5000 KVA	5000
	(ii) Above 5000 KVA	10000
6	MV Generators	
	(i) Upto 25 KVA	500
	(ii) 25 to 100 KVA	750
	(iii) 100 to 500 KVA	1500
	(iv) Above 500 KVA	2500
7	HV Switch Boards	
	(i) Upto 5 Panels	1000
	(ii) Above 5 Panels	2000
8	MV Switch Boards/Rising Mains	
	(i) 250-1000 A	500
	(ii) Above 1000A	1000
9	MV Equipment	
	(i) Upto 5 KVA	60
	(ii) 5 to 25 KVA	120
	(iii) 25- 50 KVA	200

S.No	Equipment	Rate (Rs.) for inspection under Regulation 43
	(iv) 50 to 250 KVA	300
	(v) 250-500 KVA	500
	(vi) Above 500 KVA	750
10	Others	
	(i) X- Ray	250
	(ii) Neon Sign Lamp	250
	(iii) Single phase and Lighting loads	As per (9)
	(iv) Minimum Inspection Fee	1000
	(v) Re-Inspection Fee	50% of the total Amount
11	MSB (Inclusive of Generators and Exclusive of Transformers)	
	Above 15 m and Upto 24 m	5000
	Above 24 m	10000

<This space has been intentionally left blank>